

# EZ-ZONE<sup>®</sup> PM Express User's Guide



## Limit Controller



**TOTAL  
CUSTOMER  
SATISFACTION**  
3 Year Warranty

**ISO 9001**



Registered Company  
Winona, Minnesota USA

1241 Bundy Boulevard., Winona, Minnesota USA 55987

Phone: +1 (507) 454-5300, Fax: +1 (507) 452-4507 <http://www.watlow.com>

0600-0066-0000 Rev. E

Made in the U.S.A.



April 2013

## Safety Information

We use note, caution and warning symbols throughout this book to draw your attention to important operational and safety information.

A "NOTE" marks a short message to alert you to an important detail.

A "CAUTION" safety alert appears with information that is important for protecting your equipment and performance. Be especially careful to read and follow all cautions that apply to your application.

A "WARNING" safety alert appears with information that is important for protecting you, others and equipment from damage. Pay very close attention to all warnings that apply to your application.

The electrical hazard symbol,  (a lightning bolt in a triangle) precedes an electric shock hazard CAUTION or WARNING safety statement. Further explanations follow:

Symbol	Explanation
	CAUTION – Warning or Hazard that needs further explanation than label on unit can provide. Consult users manual for further information.
	ESD Sensitive product, use proper grounding and handling techniques when installing or servicing product.
	Unit protected by double/reinforced insulation for shock hazard prevention.
	Do not throw in trash, use proper recycling techniques or consult manufacturer for proper disposal.
	Unit can be powered with either alternating current (ac) voltage or direct current (dc) voltage.
	Unit is a Listed device per Underwriters Laboratories®. It has been evaluated to United States and Canadian requirements for Process Control Equipment. UL 61010 and CSA C22.2 No. 61010. File E185611 QUXX, QUXX7. See: <a href="http://www.ul.com">www.ul.com</a>
	Unit is compliant with European Union directives. See Declaration of Conformity for further details on Directives and Standards used for Compliance.
	Unit has been reviewed and approved by Factory Mutual as a Temperature Limit Device per FM Class 3545 standard. See: <a href="http://www.fmglobal.com">www.fmglobal.com</a>
	Unit has been reviewed and approved by CSA International for use as Temperature Indicating-Regulating Equipment per CSA C22.2 No. 24. See: <a href="http://www.csa-international.org">www.csa-international.org</a>

## Warranty

This EZ-ZONE® PM is manufactured by ISO 9001 registered processes and is backed by a three year warranty to the first purchaser for use, providing that the units have not been misapplied. Watlow's obligations hereunder, at Watlow's option, are limited to replacement, repair or refund of purchase price, and parts which upon examination prove to be defective within the warranty period specified. This warranty does not apply to damage resulting from transportation, alteration, misuse or abuse. The purchaser must use Watlow parts to maintain all listed ratings.

## Technical Assistance

You can get assistance from your local Watlow representative (see back cover), send an email with your questions to: [wintechsupport@watlow.com](mailto:wintechsupport@watlow.com) or dial +1 (507) 494-5656 between 7 a.m. and 5 p.m. Central Standard Time (CST) and ask for an Applications Engineer. Please have the following information available when calling:

- Complete model number
- All configuration information
- User's Manual
- Factory Page


The EZ-ZONE PM Controller User's Guide is copyrighted by Watlow Electric, Inc., © April 2013 with all rights reserved. The EZ-ZONE PM is covered by U.S. Patent No. 6,005,577 and Patents Pending

## Product Overview


The EZ-ZONE PM Express single loop Limit controller is available in 1/4, 8<sup>th</sup>, 16<sup>th</sup> or 32<sup>nd</sup> DIN panel-mount packages. Ordering options include high or low voltage units with up to two outputs.

## Installation and Wiring


### 1/32 DIN (PM3) Dimensions

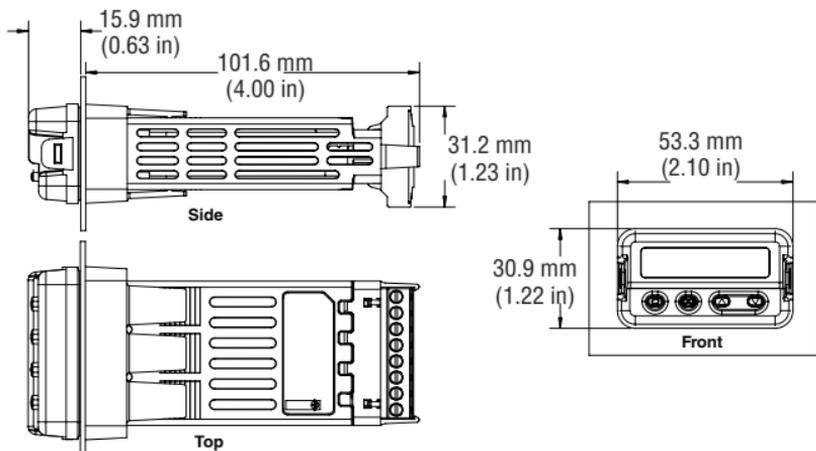


### 1/32 DIN (PM3) Recommended Panel Spacing

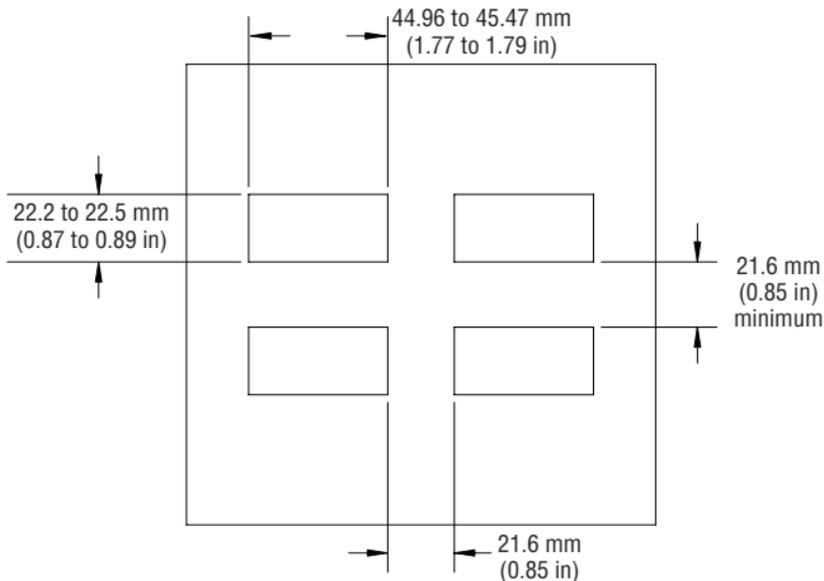


### 1/16 DIN (PM6) Dimensions

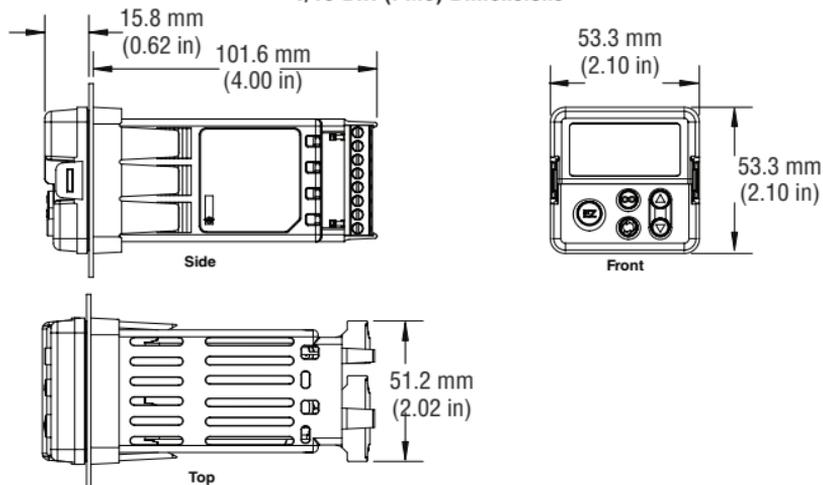


### 1/16 DIN (PM6) Recommended Panel Spacing

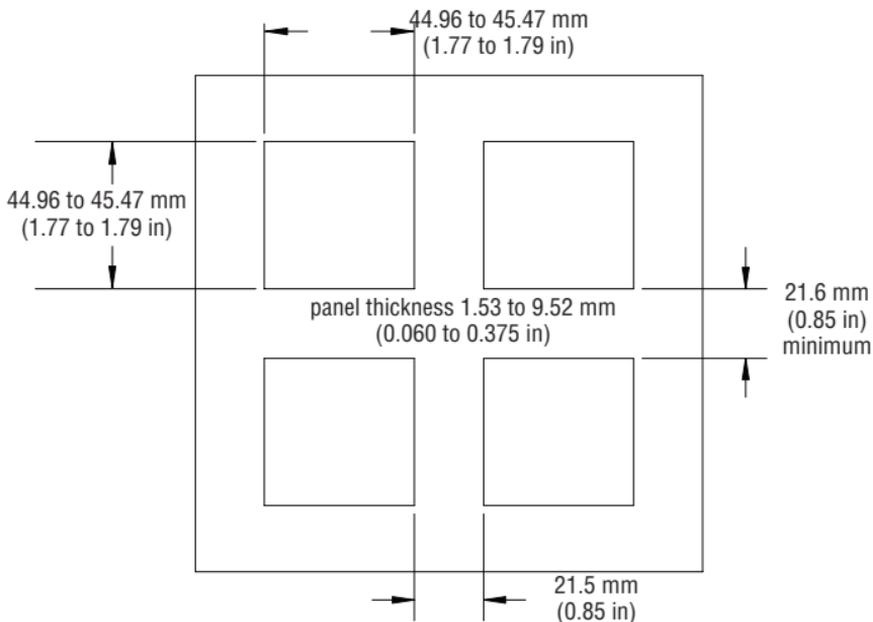


### 1/8 DIN (PM8) Vertical Dimensions

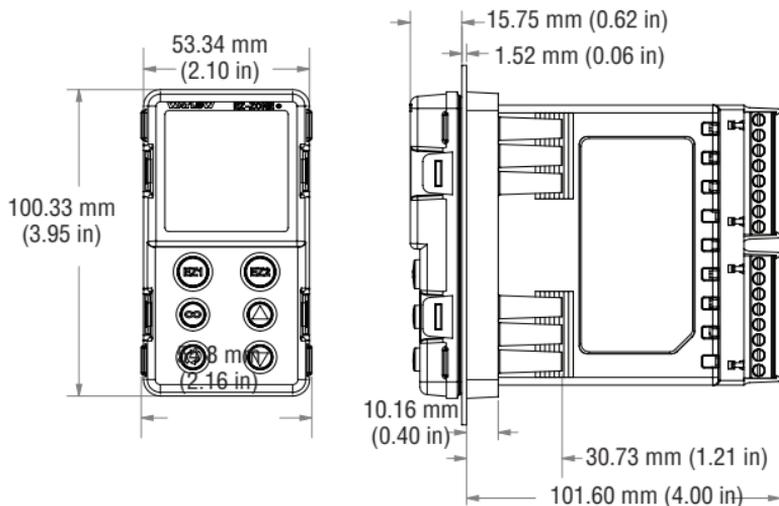


### 1/8 DIN (PM8) Vertical - Recommended Panel Spacing

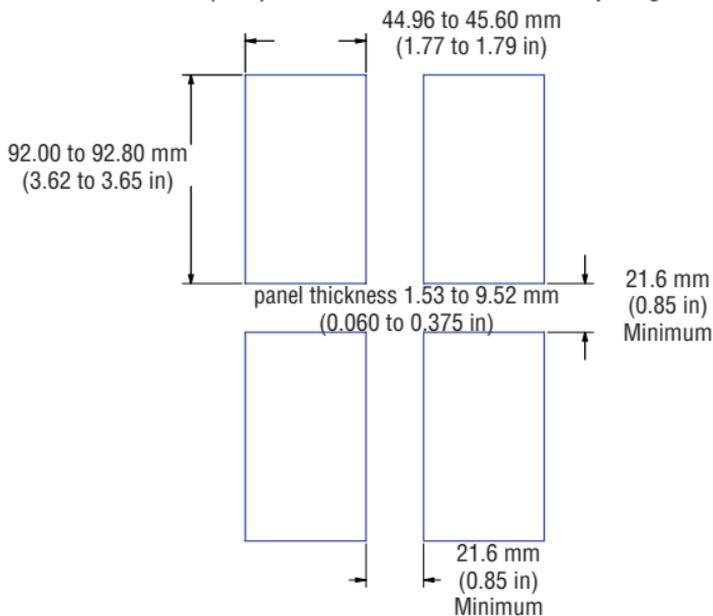




## 1/8 DIN (PM9) Horizontal Dimensions

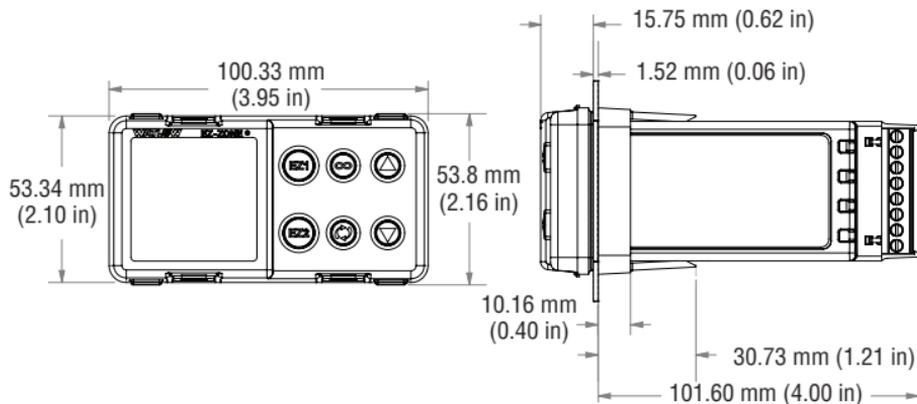


## 1/8 DIN (PM9) Horizontal Recommended Panel Spacing

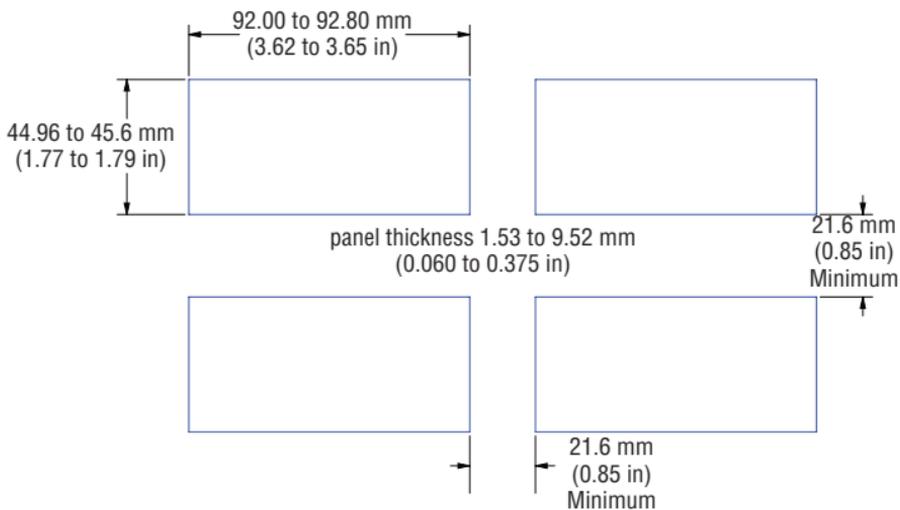

## Dimensions 1/4 DIN (PM4) Dimensions

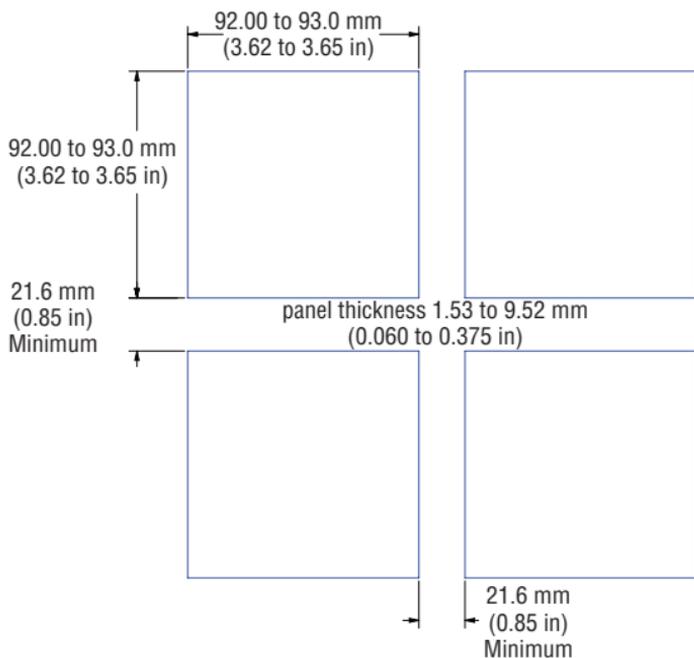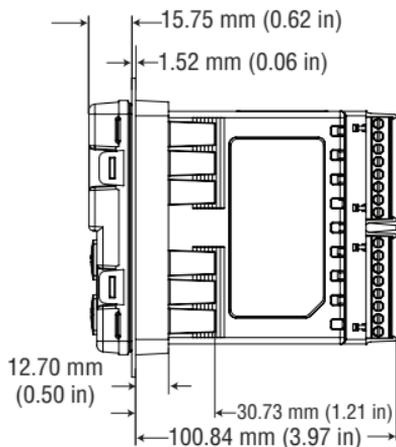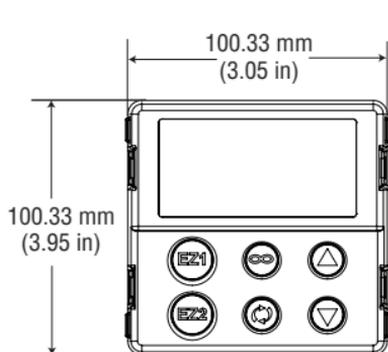

## Installation

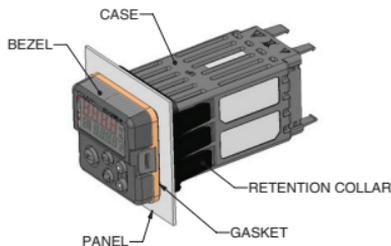

1. Make the panel cutout using the mounting template dimensions in this chapter. Insert the case assembly into the panel cutout.
2. While pressing the case assembly firmly against the panel, slide the mounting collar over the back of the controller.

If the installation does not require a NEMA 4X seal, slide the mounting collar up to the back of the panel tight enough to eliminate the spacing between the gasket and the panel.



Slide the mounting collar over the back of the controller.



Place the blade of a screwdriver in the notch of the mounting collar assembly.

3. For a NEMA 4X seal, place the blade of a screwdriver in the notch of the mounting collar assembly and push toward the panel while applying pressure to the face of the controller. Don't be afraid to apply enough pressure to properly install the controller. The seal system is compressed more by mating the mounting collar tighter to the front panel (see picture). If you can move the case assembly back and forth in the cutout, you do not have a proper seal. The tabs on each side of the mounting collar have teeth that latch into

the ridges on the sides of the controller. Each tooth is staggered at a different depth from the front so that only one of the tabs, on each side, is locked onto the ridges at a time.

### Removing the Mounted Controller from Its Case

1. From the controller's face, pull out the tab on each side until you hear it click.



Pull out the tab on each side until you hear it click.



Grab the unit above and below the face and pull forward.

2. Once the sides are released, grab the unit above and below the face with two hands and pull the unit out. If it is difficult to pull the unit out, remove the connectors from the back of the controller. This should make it easier to remove.

### ⚠ Warning:

All electrical power to the controller and controlled circuits must be disconnected before removing the controller from the front panel or disconnecting other wiring.

### Returning the Controller to its Case

1. Ensure that the orientation of the controller is correct and slide it back into the housing.
2. Using your thumbs push on either side of the controller until both latches click.

### Note:

The controller is keyed so if it feels that it will not slide back in do not force it. Check the orientation again and reinsert after correcting.

### Chemical Compatibility






This product is compatible with acids, weak alkalis, alcohols, gamma radiation and ultraviolet radiation. This product is not compatible with strong alkalis, organic solvents, fuels, aromatic hydrocarbons, chlorinated hydrocarbons, esters and keytones.

## Terminal Definitions

Slot C		Terminal Function	Model
98		power input: ac or dc+	PM _L_ _ _ - AAAAB _ _
99		power input: ac or dc-	
CF		Standard Bus EIA-485 common	PM _L_ _ _ - AAAAB _ _
CD		Standard Bus EIA-485 T-/R-	
CE		Standard Bus EIA-485 T+/R+	
<b>Slot A</b>			
<b>Input 1</b>			
T1		S2 (RTD) or current +,	Universal Sensor input 1: all configurations
S1		S3 (RTD), thermocouple -, current - or volts -, thermistor	
R1		S1 (RTD), thermocouple + or volts +, thermistor	
<b>Outputs</b>		<b>Terminal Function</b>	<b>Configuration</b>
1	2		
X1		common (Any switched dc output can use.)	Switched dc/open collector, output 1: PM _L_ (C) _ _ AAAB _ _
W1		dc- (open collector)	
Y1		dc+	
L1		normally open	Mechanical Relay 5 A, Form C, output 1: PM _L_ (E) _ _ AAAB _ _
K1		common	
J1		normally closed	
	L2	normally open	Mechanical Relay 5 A, Form A, output 2: PM _L_ _ (J)_ AAAB _ _
	K2	common	

**Note:**

In the graphics below notice that the Slot A connector does not show labeling for the outputs. Labeling for Slot A outputs is based on the controller part number.

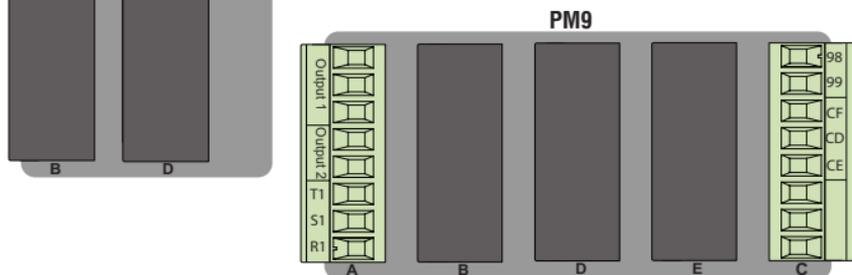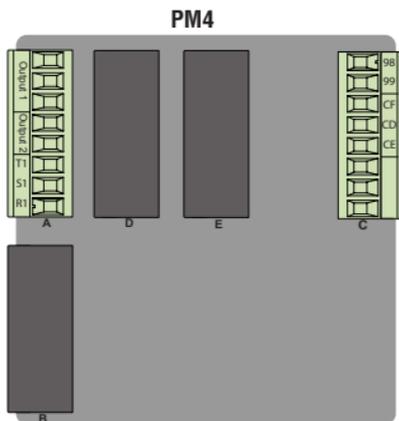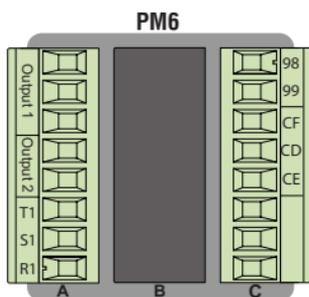



**Warning:**

Use National Electric (NEC) or other country-specific standard wiring and safety practices when wiring and connecting this controller to a power source and to electrical sensors or peripheral devices. Failure to do so may result in damage to equipment and property, and/or injury or loss of life.

**Note:**

Maximum wire size termination and torque rating:


- 0.0507 to 3.30 mm<sup>2</sup> (30 to 12 AWG) single-wire termination or two 1.31 mm<sup>2</sup> (16 AWG)
- 0.8 Nm (7.0 lb.-in.) torque

**Note:**

Adjacent terminals may be labeled differently, depending on the model number.

**Note:**

To prevent damage to the controller, do not connect wires to unused terminals.

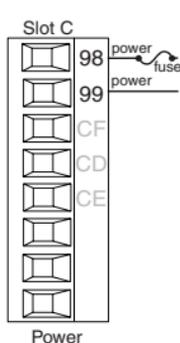

**Power**

- 47 to 63 Hz
- 10VA maximum power consumption (PM3 and PM6)
- 14VA maximum power consumption (PM4, 8 and 9)

**Low Power**

- 12 to 40V $\equiv$  (dc)
- 20 to 28V $\sim$  (ac) Semi Sig F47

**High Power**

- 85 to 264V $\sim$  (ac)
- 100 to 240V $\sim$  (ac) Semi Sig F47

**Note:**






In the drawings below for each input notice that the Slot A connector labeling is identified.

**Note:**

When using a 2 wire RTD, jumper S1 and T1 together

**Inputs**

All inputs shown below represent input 1 (the only input) and are to be connected to slot A of the Limit Control.

**Process Volts and Amperes**

- 4 to 20 mA @ 100  $\Omega$  input impedance
- 0 to 10V $\approx$  (dc) @ 20 k $\Omega$  input impedance
- Scalable

**Resistance Temperature Detector (RTD)**

- Platinum, 100  $\Omega$  @ 0 $^{\circ}$ C
- Calibration to DIN curve (0.00385  $\Omega/\Omega/^{\circ}$ C)
- 20  $\Omega$  total lead resistance
- RTD excitation current of 0.09 mA typical. Each ohm of lead resistance may affect the reading by 0.03 $^{\circ}$ C.
- For 3-wire RTDs, the S1 lead must be connected to R1.
- For best accuracy use a 3-wire RTD to compensate for lead-length resistance. All three lead wires must have the same resistance.

**Thermocouple**

- 2 K $\Omega$  maximum source resistance
- >20 M $\Omega$  input impedance
- 3 microampere open-sensor detection
- Thermocouples are polarity sensitive. The negative lead must be connected to S1.
- To reduce errors, the extension wire for thermocouples must be of the same alloy as the thermocouple.

**Thermistor**





- >20 M $\Omega$  input impedance
- 3 microampere open-sensor detection

## Outputs

Please note all outputs are connected exclusively to slot A. Output availability is based on the part number of your Limit Control.

### Note:

In the drawings below for each output notice that the Slot A connector labeling is identified with the corresponding part number below.

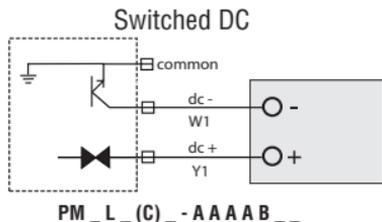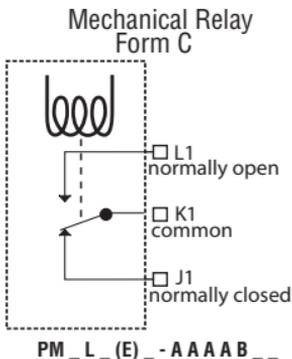

### Note:

Output 2 is always the limit.

### Quencharc Note:

Switching pilot duty inductive loads (relay coils, solenoids, etc.) with the mechanical relay, or open collector output options requires use of an R.C. suppressor (Quencharc).

## Outputs (cont.)

### Switched DC

- 22 to 32V $\approx$ (dc) @ 30mA maximum supply current
- short circuit limited to <50 mA
- 22 to 32V $\approx$ (dc) open circuit voltage
- Use dc- and dc+ to drive external solid-state relay.
- DIN-a-mite compatibility is for output 1 only.
  - single-pole: up to 4 in parallel or 4 in series
  - 2-pole: up to 2 in parallel or 2 in series
  - 3-pole: up to 2 in series

### Open Collector

- 100 mA maximum output current sink
- 30V $\approx$  (dc) maximum supply voltage
- Use an external power supply to control a dc load, with the load positive to the positive of the power supply, the load negative to the open collector and common to the power supply negative.

See Quencharc note.

### Mechanical Relay Form C

- 5 A at 240V $\sim$  (ac) or 30V $\approx$  (dc) maximum resistive load, output 1
- 20 mA at 24V minimum load
- 125 VA pilot duty at 120/240V $\sim$  (ac), 25 VA at 24V $\sim$  (ac)
- 100,000 cycles at rated load
- Output does not supply power.
- for use with ac or dc

See Quencharc note.

### Mechanical Relay Form A

- 5 A at 240V $\sim$  (ac) or 30V $\approx$  (dc) maximum resistive load, output 2
- 20 mV at 24V minimum load
- 125 VA pilot duty @ 120/240V $\sim$  (ac), 25 VA at 24V $\sim$  (ac)
- 100,000 cycles at rated load
- Output does not supply power.
- for use with ac or dc

See Quencharc note (previous page).

## Keys & Displays 16<sup>th</sup> DIN LIMIT Controller

### Zone Display:

When **[Zone]** (found in the Factory Page) is set to on, indicates the controller zone.

**[1]** to **[9]** = zones 1 to 9

**[A]** = zone 10

**[E]** = zone 14

**[B]** = zone 11

**[F]** = zone 15

**[C]** = zone 12

**[H]** = zone 16

**[D]** = zone 13

### Lower Display:

Indicates the current state of the limit **[FRIL]** or **[SAFE]**.

### EZ Key:

Performs reset function.

### RESET Key:

Press to reset limit after a trip condition has been cleared.

### Upper Display:

On power up, displays the process value, otherwise displays the value of the parameter in the lower display.

### Temperature Units Indicator Lights:

Indicates whether the temperature is displayed in Fahrenheit or Celsius.

### Output Activity:

Number lights indicate activity of outputs 1 and 2.

### Communications Activity:

Flashes when another device is communicating with this controller.

### Up and Down Keys:

When in a menu scrolls through available options for any given prompt. In other menus can change set points and modify the upper display to a higher or lower value.

### Advance Key:

Advances through parameter prompts.



Upon power-up, the upper display will briefly indicate the firmware revision and the lower display will show PMb. The "b" in this case, reflects the B in the model number.

## 32<sup>nd</sup> DIN LIMIT Controller

With a few exceptions, all of the key functions described above for the 16<sup>th</sup> DIN LIMIT apply to the 32<sup>nd</sup> DIN LIMIT controller as well.

### Left Display:

On power up, displays the process value, otherwise displays the value of the parameter in the right display.



### Right Display:

Indicates the current state of the limit **[FRIL]** or **[SAFE]**.

### Note:

As shown in the graphics on the following page the PM4, 8 and 9 controls will include two "EZ" buttons (EZ1 and EZ2). The button identified as EZ1 is equivalent to the EZ button described above where the button identified as EZ2 has no functionality. Assuming the issue that caused the limit to trip has been rectified pushing the EZ1 will reset the limit as described for the Reset button above. All other buttons found on these controls, maintain the same functionality as described above for the 16<sup>th</sup> DIN.

## Keys & Displays for 1/8<sup>th</sup> or 1/4 DIN PID Controllers

### PM9



### PM8



### PM4



## Responding to a Displayed Message

An active message will cause the display to toggle between the normal settings and the active message in the upper or left display and **AL1** in the lower or right display.

Your response will depend on the message and the controller settings. If the message is generated by a latched alarm or limit condition, the message can be silenced **SIL** or cleared **CLR** by simply pushing the reset key **RESET** when the condition no longer exists.

**AL1** Alarm 1 Low (sensor input below low alarm set point)

**ALH1** Alarm 1 High (sensor input above high alarm set point)

Alarm Error 1

**AL1** Alarm 1 Error (alarm state cannot be determined due to lack of sensor input)

**Er1** Error Input 1 (sensor is not providing a valid signal to the control)


**L1L1** Limit Low 1 (sensor input below low limit set point)

**L1H1** Limit High 1 (sensor input above high limit set point)

**LiE1** Limit Error 1 (limit state cannot be determined due to lack of sensor input, limit will trip)

Upon power up of the control, using the advance key will scroll through the various prompts found in the Operations Menu. At any point within the Operations menu to return to the default display push the Reset **RESET** key.

### Operations Menu

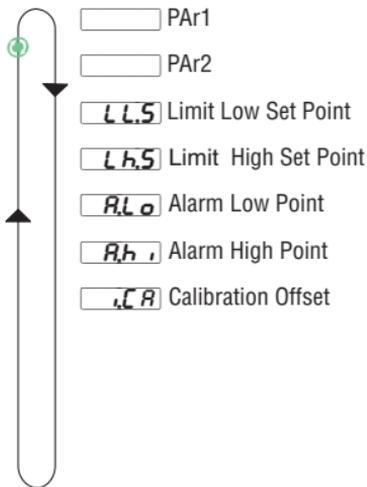

### Operations Menu

<i>Display</i>	<i>Parameter Name Description</i>	
<input type="text" value="L.L.S"/> [ L.L.S]	<b>Limit Low Set Point</b> Set the low process value that will trigger the limit. Appears if: Limit sides set to low or both.	
<input type="text" value="L.h.S"/> [ L.h.S]	<b>Limit High Set Point</b> Set the high process value that will trigger the limit. Appears if: Limit sides set to high or both.	
<input type="text" value="A.L.o"/> [ A.Lo]	<b>Alarm Low Set Point</b> Process - set the process value that will trigger a low alarm. Appears if: Alarm Type (A.ty) is set to Process Alarm	
<input type="text" value="A.h.i"/> [ A.hi]	<b>Alarm High Set Point</b> Process - set the process value that will trigger a high alarm. Appears if: Alarm Type (A.ty) is set to Process Alarm	
<input type="text" value="i.C.A"/> [ i.CA]	<b>Calibration Offset</b> Set an offset value for a process output. Appears if: Always	

	<b>Range</b> Defaults are shown <b>bold</b>
	-1,999.000 to 9,999.000°F or units -1,128.000 to 5,537.000°C <b>Units, 0.0°F or -18.0°C</b>
	-1,999.000 to 9,999.000°F or units -1,128.000 to 5,537.000°C <b>Units, 0.0°F or -18.0°C</b>
	-1,999.000 to 9,999.000°F or units -1,128.000 to 5,537.000°C <b>Units, 32.0°F or 0.0°C</b>
	-1,999.000 to 9,999.000°F or units -1,128.000 to 5,537.000°C <b>Units, 300.0°F or 150.0°C</b>
	-1,999.000 to 9,999.000°F or units -1,110.555 to 5,555.000°C <b>0.0</b>

To enter the Setup Menu push and hold the up and down arrow keys for approximately 3 seconds. Once there, push the green advance key to scroll through to the prompt of choice and then use the up and down arrow keys to change the range. At any point within the Setup menu to return to the default display push the Reset **RESET** key.

## Setup Menu

- 
- LoC** Lockout Menu
  - SEn** Sensor Type
  - Lin** Linearization
  - t.C** Thermistor Curve
  - r.r** Resistance Range
  - dEC** Decimal
  - C\_F** Display Units
  - r.Lo** Limit Set Point Range Low
  - ch.i** Limit Set Point Range High
  - Fn1** Function Output One
  - Fn2** Function Output Two
  - L.Sd** Limit Sides
  - L.hY** Limit Hysteresis
  - ALY** Alarm Type
  - RhY** Alarm Hysteresis
  - RL9** Alarm Logic
  - RLA** Alarm Latching
  - RbL** Alarm Blocking
  - RS** Alarm Silencing
  - RdSP** Alarm Display
  - PRr1** Upper or Left Display
  - PRr2** Lower or Right Display
  - RdS** Zone Address

## Setup Menu

<i>Display</i>	<i>Parameter Name Description</i>	
<b>LoC</b> [LoC]	<b>Lockout Menu</b> Set the security clearance level. The user can access the selected level and all lower levels. Appears if: Always	
<b>SEn</b> [SEn]	<b>Sensor Type</b> Set the analog sensor type to match the device wired to this input. Appears if: Always.	
<b>Lin</b> [Lin]	<b>Linearization</b> Set the linearization to match the thermocouple type wired to this input. For example, select <b>H</b> for a type K thermocouple. Appears if: Sensor Type is set to Thermocouple.	
<b>t.C</b> [ t.C]	<b>Thermistor Curve</b> Select a curve to apply to the thermistor input.	
<b>r.r</b> [ r.r]	<b>Resistance Range</b> Set the maximum resistance of the thermistor input.	
<b>dEC</b> [ dEC]	<b>Decimal</b> Set the precision of the displayed value. Appears if: Always.	
<b>C_F</b> [ C_F]	<b>Display Units</b> Select which units will be displayed. Appears if: Always.	
<b>r.Lo</b> [ r.Lo]	<b>Limit Set Point - Range Low</b> Sets the low limit of the set point adjustment using a T/C and RTD; scales for process inputs. Appears if: Always.	

**Range** (Defaults are shown **bold**)

1 to 5

1 Operations Menu (read only)\*

2 Operations Menu (Set point R/W)\*

3 Operations Menu (Set point R/W, Control Mode R/W)\*

4 Operations Menu R/W access)\*

**5 Operations Menu and Setup Menu full R/W access**

\*You can change the security level at any level

**E** Thermocouple

**P** Milliamps dc

**V** Volts dc

**R** RTD 100  $\Omega$

**B**

**J**

**T**

**C**

**H**

**K**

**D**

**N**

**E**

**R**

**S**

**F**

**S**

**A** Curve A,  **B** Curve B,  **C** Curve C

**U** Custom

**5** 5K,  **10** 10K,  **20** 20K,  **40** 40K

**0** Whole

**00** Tenths

**000** Hundredths

**F** °F

**C** °C

-1,999.00 to 9,999.000 °F or Units

-1,110.555 to 5,555.000 °C

**0.0**

To enter the Setup Menu push and hold the up and down arrow keys for approximately 3 seconds. Once there, push the green advance key to scroll through to the prompt of choice and then use the up and down arrow keys to change the range. At any point within the Setup menu to return to the default display push the Reset **RESET** key.

## Setup Menu

- 
- LoC** Lockout Menu
  - SEn** Sensor Type
  - Lin** Linearization
  - EC** Thermistor Curve
  - RR** Resistance Range
  - dEC** Decimal
  - CF** Display Units
  - rLo** Limit Set Point Range Low
  - rHi** Limit Set Point Range High
  - Fn1** Function Output One
  - Fn2** Function Output Two
  - LSd** Limit Sides
  - LHy** Limit Hysteresis
  - REY** Alarm Type
  - RHy** Alarm Hysteresis
  - RL9** Alarm Logic
  - RLA** Alarm Latching
  - RLB** Alarm Blocking
  - RS** Alarm Silencing
  - RdSP** Alarm Display
  - PRr1** Upper or Left Display
  - PRr2** Lower or Right Display
  - RdS** Zone Address

## Setup Menu (cont.)

Display	Parameter Name Description	
<b>rHi</b> [ r.hi]	<b>Limit Set Point - Range High</b> Sets the high limit of the set point adjustment using a T/C and RTD; scales for process inputs. Appears if: Always.	
<b>Fn1</b> [ fn1]	<b>Function of Output 1</b> Select which function will drive this output. Appears if: Always.	
<b>Fn2</b> [ fn2]	<b>Function of Output 2</b> Select which function will drive this output. Appears if: Always.	
<b>LSd</b> [ L.Sd]	<b>Limit Sides</b> Select which side or sides of the process value will be monitored. Appears if: Always.	
<b>LHy</b> [ L.hy]	<b>Limit Hysteresis</b> Set the hysteresis for the limit function. This determines how far into the safe range the process value must move before the limit turns the output back on. Appears if: Always.	
<b>REY</b> [ A.ty]	<b>Alarm Type</b> Select how the alarm will or will not track the set point. Appears if: Always.	
<b>RHy</b> [ A.hy]	<b>Alarm Hysteresis</b> Set the hysteresis for an alarm. This determines how far into the safe region the process value needs to move before the alarm can be cleared. Appears if: When alarm type is set to process.	
<b>RL9</b> [A.Lg]	<b>Alarm Logic</b> Select what the output condition will be during the alarm state. Appears if: Always	

	<b>Range</b> (Defaults are shown <b>bold</b> )
	-1,999.00 to <b>9,999.000</b> °F or Units -1,110.555 to 5,555.000 °C
	<input type="checkbox"/> <b>OFF</b> Off, <input type="checkbox"/> <b>LIM</b> Limit*, <input type="checkbox"/> <b>ALM</b> Alarm  <b>*Note:</b> Switched DC/Open Collector option should only be used to control an external mechanical relay if Limit function is selected.
	<input type="checkbox"/> <b>LIM</b> Limit  <b>Note:</b> Output 2 (only) is FM approved as a limit.
	<input type="checkbox"/> <b>both</b> Both <input type="checkbox"/> <b>High</b> High <input type="checkbox"/> <b>Low</b> Low
	0.001 to 9,999.0°F or units 0.001 to 5,555.0°C <b>Units, 3.0°F or 2°C</b>
	<input type="checkbox"/> <b>OFF</b> Off <input type="checkbox"/> <b>PrAL</b> Process Alarm
	0.001 to 9,999.000°F or units 0.001 to 5,555.000°C <b>Units, 1.0°F or 1.0°C</b>
	<input type="checkbox"/> <b>RLC</b> Close on Alarm <input type="checkbox"/> <b>RLo</b> Open on alarm

To enter the Setup Menu push and hold the up and down arrow keys for approximately 3 seconds. Once there, push the green advance key to scroll through to the prompt of choice and then use the up and down arrow keys to change the range. At any point within the Setup menu to return to the default display push the Reset **RESET** key.

## Setup Menu

- 
- LoC** Lockout Menu
  - SEn** Sensor Type
  - Lin** Linearization
  - t.C** Thermistor Curve
  - r.r** Resistance Range
  - dEC** Decimal
  - C\_F** Display Units
  - r.Lo** Limit Set Point Range Low
  - ch.i** Limit Set Point Range High
  - Fn1** Function Output One
  - Fn2** Function Output Two
  - LSd** Limit Sides
  - LhY** Limit Hysteresis
  - REY** Alarm Type
  - RhY** Alarm Hysteresis
  - RL9** Alarm Logic
  - RLA** Alarm Latching
  - RbL** Alarm Blocking
  - RS,** Alarm Silencing
  - RdSP** Alarm Display
  - PRr1** Upper or Left Display
  - PRr2** Lower or Right Display
  - RdS** Zone Address

## Setup Menu (cont.)

Display	Parameter Name Description	
<b>LoC</b> [LoC]	<b>Lockout Menu</b> Set the security clearance level. The user can access the selected level and all lower levels. Appears if: Always	
<b>SEn</b> [SEn]	<b>Sensor Type</b> Set the analog sensor type to match the device wired to this input. Appears if: Always.	
<b>Lin</b> [Lin]	<b>Linearization</b> Set the linearization to match the thermocouple type wired to this input. For example, select <b>H</b> for a type K thermocouple. Appears if: Sensor Type is set to Thermocouple.	
<b>t.C</b> [t.C]	<b>Thermistor Curve</b> Select a curve to apply to the thermistor input.	
<b>r.r</b> [r.r]	<b>Resistance Range</b> Set the maximum resistance of the thermistor input.	
<b>dEC</b> [dEC]	<b>Decimal</b> Set the precision of the displayed value. Appears if: Always.	
<b>C_F</b> [C_F]	<b>Display Units</b> Select which units will be displayed. Appears if: Always.	
<b>r.Lo</b> [r.Lo]	<b>Limit Set Point - Range Low</b> Sets the low limit of the set point adjustment using a T/C and RTD; scales for process inputs. Appears if: Always.	

**Range** (Defaults are shown **bold**)

1 to 5

1 Operations Menu (read only)\*

2 Operations Menu (Set point R/W)\*

3 Operations Menu (Set point R/W, Control Mode R/W)\*

4 Operations Menu R/W access)\*

**5 Operations Menu and Setup Menu full R/W access**

\*You can change the security level at any level

**EE** Thermocouple

**PPH** Milliamps dc

**uVLE** Volts dc

**rD, 1H** RTD 100 Ω

**b** B

**J** J

**E** T

**c** C

**H** K

**d** D

**n** N

**E** E

**r** R

**F** F

**S** S

**A** Curve A,  **b** Curve B,  **C** Curve C

**USE** Custom

**5** 5K,  **10** 10K,  **20** 20K,  **40** 40K

**0** Whole

**00** Tenths

**000** Hundredths

**F** °F

**C** °C

-1,999.00 to 9,999.000 °F or Units

-1,110.555 to 5,555.000 °C

**0.0**

To enter the Setup Menu push and hold the up and down arrow keys for approximately 3 seconds. Once there, push the green advance key to scroll through to the prompt of choice and then use the up and down arrow keys to change the range. At any point within the Setup menu to return to the default display push the Reset **RESET** key.

## Setup Menu

- 
- LoC** Lockout Menu
  - SEn** Sensor Type
  - Lin** Linearization
  - EC** Thermistor Curve
  - RR** Resistance Range
  - dEC** Decimal
  - CF** Display Units
  - rLo** Limit Set Point Range Low
  - rhi** Limit Set Point Range High
  - Fn1** Function Output One
  - Fn2** Function Output Two
  - LSd** Limit Sides
  - Lhy** Limit Hysteresis
  - REY** Alarm Type
  - Rhy** Alarm Hysteresis
  - RL9** Alarm Logic
  - RLA** Alarm Latching
  - RbL** Alarm Blocking
  - RS** Alarm Silencing
  - RdSP** Alarm Display
  - PRr1** Upper or Left Display
  - PRr2** Lower or Right Display
  - RdS** Zone Address

## Setup Menu (cont.)

<i>Display</i>	<i>Parameter Name Description</i>	
<b>rhi</b> [ r.hi]	<b>Limit Set Point - Range High</b> Sets the high limit of the set point adjustment using a T/C and RTD; scales for process inputs. Appears if: Always.	
<b>Fn1</b> [ fn1]	<b>Function of Output 1</b> Select which function will drive this output. Appears if: Always.	
<b>Fn2</b> [ fn2]	<b>Function of Output 2</b> Select which function will drive this output. Appears if: Always.	
<b>LSd</b> [ L.Sd]	<b>Limit Sides</b> Select which side or sides of the process value will be monitored. Appears if: Always.	
<b>Lhy</b> [ L.hy]	<b>Limit Hysteresis</b> Set the hysteresis for the limit function. This determines how far into the safe range the process value must move before the limit turns the output back on. Appears if: Always.	
<b>REY</b> [ A.ty]	<b>Alarm Type</b> Select how the alarm will or will not track the set point. Appears if: Always.	
<b>Rhy</b> [ A.hy]	<b>Alarm Hysteresis</b> Set the hysteresis for an alarm. This determines how far into the safe region the process value needs to move before the alarm can be cleared. Appears if: When alarm type is set to process.	
<b>RL9</b> [A.Lg]	<b>Alarm Logic</b> Select what the output condition will be during the alarm state. Appears if: Always	

	<b>Range</b> (Defaults are shown <b>bold</b> )
	-1,999.00 to <b>9,999.000</b> °F or Units -1,110.555 to 5,555.000 °C
	<input type="checkbox"/> <b>OFF</b> Off, <input type="checkbox"/> <b>LIMIT</b> Limit*, <input type="checkbox"/> <b>ALARM</b> Alarm  *Note: Switched DC/Open Collector option should only be used to control an external mechanical relay if Limit function is selected.
	<input type="checkbox"/> <b>LIMIT</b> Limit  Note: Output 2 (only) is FM approved as a limit.
	<input type="checkbox"/> <b>both</b> Both <input type="checkbox"/> <b>High</b> High <input type="checkbox"/> <b>Low</b> Low
	0.001 to 9,999.0°F or units 0.001 to 5,555.0°C <b>Units, 3.0°F or 2°C</b>
	<input type="checkbox"/> <b>OFF</b> Off <input type="checkbox"/> <b>PrAL</b> Process Alarm
	0.001 to 9,999.000°F or units 0.001 to 5,555.000°C <b>Units, 1.0°F or 1.0°C</b>
	<input type="checkbox"/> <b>RLC</b> Close on Alarm <input type="checkbox"/> <b>RLo</b> Open on alarm

To enter the Setup Menu push and hold the up and down arrow keys for approximately 3 seconds. Once there, push the green advance key to scroll through to the prompt of choice and then use the up and down arrow keys to change the range. At any point within the Setup menu to return to the default display push the Reset **RESET** key.

## Setup Menu

- 
- LoC** Lockout Menu
  - SEn** Sensor Type
  - Lin** Linearization
  - EC** Thermistor Curve
  - RR** Resistance Range
  - dEC** Decimal
  - [.F]** Display Units
  - rLo** Limit Set Point Range Low
  - chI** Limit Set Point Range High
  - Fo1** Function Output One
  - Fo2** Function Output Two
  - LSd** Limit Sides
  - LhY** Limit Hysteresis
  - REY** Alarm Type
  - RhY** Alarm Hysteresis
  - RL9** Alarm Logic
  - RLA** Alarm Latching
  - RbL** Alarm Blocking
  - RS,** Alarm Silencing
  - RdSP** Alarm Display
  - PAR1** Upper or Left Display
  - PAR2** Lower or Right Display
  - RdS** Zone Address

## Setup Menu (cont.)

<i>Display</i>	<i>Parameter Name Description</i>	
<b>RLA</b> [A.LA]	<b>Alarm Latching</b> Turn alarm latching on or off. A latched alarm has to be turned off by the user. Appears if: When alarm type is set to process.	
<b>RbL</b> [A.bL]	<b>Alarm Blocking</b> Select when an alarm will be blocked. After startup and/or after the set point changes, the alarm will be blocked until the process value enters the normal range. Appears if: When alarm type is set to process.	
<b>RS,</b> [A.Si]	<b>Alarm Silencing</b> Turn alarm silencing on to allow the user to disable the output tied (configured) to this alarm Appears if: Always.	
<b>RdSP</b> [A.dSP]	<b>Alarm Display</b> Display an alarm message when an alarm is active. Appears if: When alarm type is set to process.	
<b>PAR1</b> [PAR1]	<b>Upper or Left Display</b> Select parameter to display. Appears if: Always.	
<b>PAR2</b> [PAR2]	<b>Lower or Right Display</b> Select parameter to display. Appears if: Always.	
<b>RdS</b> [Ad.S]	<b>Zone Address - Standard Bus Communication</b> Set zone address from 1-16. Appears if: Always.	

<b>Range</b> (Defaults are shown <b>bold</b> )	
<input type="checkbox"/> <b>nLRE</b> Non-Latching <input type="checkbox"/> <b>LRE</b> Latching	
<input type="checkbox"/> <b>oFF</b> Off <input type="checkbox"/> <b>SEr</b> Startup <input type="checkbox"/> <b>SEPe</b> Set Point <input type="checkbox"/> <b>boTh</b> Both	
<input type="checkbox"/> <b>oFF</b> Off <input type="checkbox"/> <b>oN</b> On	
<input type="checkbox"/> <b>oFF</b> Off <input type="checkbox"/> <b>oN</b> On	
<input type="checkbox"/> <b>APV</b> Active Process Value <input type="checkbox"/> <b>noNE</b> None	
<input type="checkbox"/> <b>LSE</b> Limit State <input type="checkbox"/> <b>LHS</b> Limit High Set Point <input type="checkbox"/> <b>LSS</b> Limit Low Set Point	<input type="checkbox"/> <b>AlH</b> Alarm High Set Point <input type="checkbox"/> <b>ALo</b> Alarm Low Set Point <input type="checkbox"/> <b>noNE</b> None
1-16 <b>1</b>	

## Specifications

### Line Voltage/Power

- All voltage levels represent minimums and maximums
- 85 to 264V~(ac), 47 to 63Hz
- 20 to 28V~(ac), +10/-15 percent; 50/60Hz,  $\pm 5$  percent
- 12 to 40V=(dc)
- 10VA maximum power consumption (PM3 and PM6)
- 14VA maximum power consumption (PM4, 8 and 9)
- Data retention upon power failure via nonvolatile memory
- Compliant with SEMI F47-0200, Figure R1-1 voltage sag requirements @ 24V~(ac) or higher

### Environment

- -18 to 65°C (0 to 149°F) operating temperature
- -40 to 85°C (-40 to 185°F) storage temperature
- 0 to 90 percent RH, non-condensing

### Accuracy

- Calibration accuracy and sensor conformity:  $\pm 0.1$  percent of span,  $\pm 1^\circ\text{C}$  @ the calibrated ambient temperature and rated line voltage
- Type S, 0.2 percent
- Type T, below  $-50^\circ\text{C}$ ; 0.2 percent
- Calibration ambient temperature @  $25^\circ\text{C} \pm 3^\circ\text{C}$  ( $77^\circ\text{F} \pm 5^\circ\text{F}$ )
- Accuracy span:  $540^\circ\text{C}$  ( $1000^\circ\text{F}$ ) minimum
- Temperature stability:  $\pm 0.1^\circ\text{C}/^\circ\text{C}$  ( $\pm 0.1^\circ\text{F}/^\circ\text{F}$ ) rise in ambient maximum

### Agency Approvals

- cULus® UL/EN/CSA C22.2 No. 61010-1 Listed File E185611
- cULus® ANSI/ISA 12.12.01-2007, CSA-C22.2 No.213-1987, Class 1 Division 2 Groups A, B, C and D, Temperature Code T4A, File E184390 (optional)
- UL® 50, 4X indoor locations, NEMA 4X, IP66 front seal
- CSA C22.2 No. 24 File 158031 (1/32 and 1/16 DIN sizes)
- CE, RoHS by design, W.E.E.E.
- FM Class 3545 File 3029084
- SEMI F47-0200

### Serial Communications

- Isolated communications
- Standard Bus Configuration Protocol

### Wiring Termination—Touch-Safe Terminals

- Input, power and controller output terminals are touch safe removable 12 to 22 AWG
- Use  $75^\circ\text{C}$ , Cu conductor only

### Universal Input

- Thermocouple, grounded or ungrounded sensors
- $>20\text{M}\Omega$  input impedance
- Maximum of  $2\text{k}\Omega$  source resistance (applies to T/C only)
- RTD 2- or 3-wire, platinum,  $100\Omega$  @  $0^\circ\text{C}$  calibration to DIN curve ( $0.00385 \Omega/\Omega^\circ\text{C}$ )
- Process, 4-20mA @  $100\Omega$ , or 0-10V=(dc) @  $20\text{k}\Omega$  input impedance; scalable

## Specifications (cont.)

### Thermistor Input (Not included with Universal Input)

Thermistor Input				
Input Type	Max Error @ 25 Deg C	Accuracy Range Low	Accuracy Range High	Units
Thermistor, 5K range	±5	0	5000	Ohms
Thermistor, 10K range	±10	0	10000	Ohms
Thermistor, 20K range	±20	0	20000	Ohms
Thermistor, 40K range	±40	0	40000	Ohms

- 0 to 40KΩ, 0 to 20KΩ, 0 to 10KΩ, 0 to 5KΩ
- 2.252KΩ and 10KΩ base at 77°F (25°C)
- Linearization curves built in
- Third party Thermistor compatibility requirements

Base R @ 25C	Alpha Techniques	Beta THERM	YSI	Prompt <input type="text" value="E C"/>
2.252K	Curve A	2.2K3A	004	A
10K	Curve A	10K3A	016	B
10K	Curve C	10K4A	006	C

### Functional Operating Range

- Type B: -50 to 1816°C (-58 to 3301°F)
- Type C: 0 to 2315°C (32 to 4199°F)
- Type D: 0 to 2315°C (-328 to 4199°F)
- Type E: -270 to 1000°C (-454 to 1832°F)
- Type F: 0 to 1343°C (32 to 2449°F)
- Type J: -210 to 1200°C (-346 to 2192°F)
- Type K: -270 to 1371°C (-454 to 2500°F)
- Type N: -200 to 1300°C (-328 to 2372°F)
- Type R: -50 to 1767°C (-58 to 3213°F)
- Type S: -50 to 1767°C (-58 to 3213°F)
- Type T: -270 to 400°C (-454 to 752°F)
- RTD (DIN): -200 to 800°C (-328 to 1472°F)
- Process: -1999 to 9999 units

## Specifications (cont.)

### Output Hardware

- Switched dc
  - 22 to 32V=(dc) @ 30mA
- Open collector, maximum sink current 100 mA, @ 30V=(dc)
- Electromechanical relay, Form C, 5A, 24 to 240V~(ac) or 30V=(dc) maximum, resistive load, 100,000 cycles at rated load
- Electromechanical relay, Form A, 5A, 24 to 240V~(ac) or 30V=(dc) maximum, resistive load, 100,000 cycles at rated load

### Operator Interface

- Dual 4 digit, 7 segment LED displays
- Typical display update rate 1Hz
- Advance, RESET, up and down keys plus an EZ-Key/s (not available in 1/32 DIN)

---

## Ordering Part Number (Part number digits 1 through 14)

**PMXLXXX-AAAABXX**

All Models include: \*Universal Sensor Input, Standard Bus Configuration Communications

\*Dual line Red over Green 7 Segment displays

### Package Size (Digit #3)

3 = 1/32 DIN

6 = 1/16 DIN

8 = 1/8 DIN vertical

9 = 1/8 DIN horizontal

4 = 1/4 DIN

### Primary Function (Digit #4)

L = Limit Controller w/ Universal Input

### Power Supply (Digit #5)

1 = 100-240 VAC

3 = 12-28 VAC/DC

### Output 1 and 2 Hardware Options (Digits #6 and #7)

Output 1

AJ = None

CJ = Switched dc/open collector

EJ = Mechanical Relay 5 Amp form C

Output 2

Mechanical relay 5A, Form A

Mechanical relay 5A, Form A

Mechanical relay 5A, Form A

### Future Options (Digits #8 thru #11)

AAAA = None

### Menu Type (Digits #12)

B = Express

### Additional Options (Digits #13 and #14)

AA = Standard EZ-ZONE face plate

AB = EZ-ZONE logo and no Watlow name

AC = No logo and no Watlow name

# Declaration of Conformity

## Series EZ-ZONE<sup>®</sup> PM



**WATLOW**  
1241 Bundy Blvd.  
Winona, MN 55987 USA

an ISO 9001 approved facility since 1996.

Declares that the following product:

Designation: **Series EZ-ZONE<sup>®</sup> PM (Panel Mount)**  
Model Numbers: PM (3, 6, 8, 9 or 4)(Any Letter or number) – (1, 2, 3 or 4)(A, C, E, F or K) (A, C, H, J or K)(Any letter or number) – (Any letter or number)(A, C, E, F or K)(A, C, H, J or K) (Any three letters or numbers)  
Classification: Temperature control, Installation Category II, Pollution degree 2, IP66  
Rated Voltage and Frequency: 100 to 240 V~ (ac 50/60 Hz) or 15 to 36 VDC/ 24 V~ac 50/60 Hz  
Rated Power Consumption: 10 VA maximum PM3, PM6 Models.  
14 VA maximum PM8, PM9, PM4 Models

Meets the essential requirements of the following European Union Directives by using the relevant standards show below to indicate compliance.

### **2004/108/EC Electromagnetic Compatibility Directive**

<b>EN 61326-1</b>	<b>2006</b>	<b>Electrical equipment for measurement, control and laboratory use – EMC requirements (Industrial Immunity, Class B Emissions).</b>
EN 61000-4-2	1996 +A1,A2	Electrostatic Discharge Immunity
EN 61000-4-3	2006	Radiated Field Immunity 10V/M 80–1000 MHz, 3 V/M 1.4–2.7 GHz
EN 61000-4-4	2004	Electrical Fast-Transient / Burst Immunity
EN 61000-4-5	2006	Surge Immunity
EN 61000-4-6	1996 +A1,A2,A3	Conducted Immunity
EN 61000-4-11	2004	Voltage Dips, Short Interruptions and Voltage Variations Immunity
EN 61000-3-2	2006	Harmonic Current Emissions
EN 61000-3-3 <sup>1</sup>	2005	Voltage Fluctuations and Flicker
SEMI F47	2000	Specification for Semiconductor Sag Immunity Figure R1-1

<sup>1</sup>For mechanical relay loads, cycle time may need to be extended up to 160 seconds to meet flicker requirements depending on load switched and source impedance.

### **2006/95/EC Low-Voltage Directive**

<b>EN 61010-1</b>	<b>2001</b>	<b>Safety Requirements of electrical equipment for measurement, control and laboratory use. Part 1: General requirements</b>
-------------------	-------------	--

### **Compliant with 2002/95/EC RoHS Directive**


Per 2002/96/EC W.E.E.E Directive  Please Recycle Properly.

Raymond D. Feller III  
Name of Authorized Representative

Winona, Minnesota, USA  
Place of Issue

General Manager  
Title of Authorized Representative

June 2009  
Date of Issue

  
Signature of Authorized Representative

# How to Reach Us

## Corporate Headquarters

Watlow Electric Manufacturing Company  
12001 Lackland Road  
St. Louis, MO 63146  
Sales: 1-800-WATLOW2  
Manufacturing Support: 1-800-4WATLOW  
Email: info@watlow.com  
Website: [www.watlow.com](http://www.watlow.com)  
From outside the USA and Canada:  
Tel: +1 (314) 878-4600  
Fax: +1 (314) 878-6814

## Latin America

Watlow de México S.A. de C.V.  
Av. Fundición No. 5  
Col. Parques Industriales  
Querétaro, Qro. CP-76130  
Mexico  
Tel: +52 442 217-6235  
Fax: +52 442 217-6403

## Asia and Pacific

Watlow Singapore Pte Ltd.  
16 Ayer Rajah Crescent,  
#06-03/04,  
Singapore 139965  
Tel: +65 6773 9488 Fax: +65 6778 0323  
Email: info@watlow.com.sg Website: [www.watlow.com.sg](http://www.watlow.com.sg)

Watlow Australia Pty., Ltd.  
4/57 Sharps Road  
Tullamarine, VIC 3043  
Australia  
Tel: +61 3 9335 6449  
Fax: +61 3 9330 3566  
Website: [www.watlow.com](http://www.watlow.com)

Watlow Electric Manufacturing (Shanghai) Company  
1118 Fangyuan Road, Anting Industrial Park, Jiading, Shanghai,  
PRC 201203  
People's Republic of China  
Tel: +86 21 39509510  
Fax: +86 21 5080-0906  
Email: info@watlow.cn  
Website: [www.watlow.cn](http://www.watlow.cn)

ワトロー・ジャパン株式会社  
〒101-0047 東京都千代田区内神田1-14-4  
四国ビル別館9階  
Tel: 03-3518-6630 Fax: 03-3518-6632  
Email: infoj@watlow.com Website: [www.watlow.co.jp](http://www.watlow.co.jp)

Watlow Japan Ltd.  
1-14-4 Uchikanda, Chiyoda-Ku  
Tokyo 101-0047  
Japan  
Tel: +81-3-3518-6630 Fax: +81-3-3518-6632  
Email: infoj@watlow.com Website: [www.watlow.co.jp](http://www.watlow.co.jp)

## Europe

Watlow France  
Tour d'Asnières.  
4 Avenue Laurent Cély  
92600 Asnières sur Seine  
France  
Tél: + 33 (0)1 41 32 79 70  
Télécopie: + 33(0)1 47 33 36 57  
Email: info@watlow.fr  
Website: [www.watlow.fr](http://www.watlow.fr)

Watlow GmbH  
Postfach 11 65, Lauchwasenstr. 1  
D-76709 Kronau  
Germany  
Tel: +49 (0) 7253 9400-0  
Fax: +49 (0) 7253 9400-900  
Email: info@watlow.de  
Website: [www.watlow.de](http://www.watlow.de)

Watlow Italy S.r.l.  
Viale Italia 52/54  
20094 Corsico MI  
Italy  
Tel: +39 024588841  
Fax: +39 0245869954  
Email: italyinfo@watlow.com  
Website: [www.watlow.it](http://www.watlow.it)

Watlow Ibérica, S.L.U.  
C/Marte 12, Posterior, Local 9  
E-28850 Torrejón de Ardoz  
Madrid - Spain  
T. +34 91 675 12 92  
F. +34 91 648 73 80  
Email: info@watlow.es  
Website: [www.watlow.es](http://www.watlow.es)

Watlow UK Ltd.  
Linby Industrial Estate  
Linby, Nottingham, NG15 8AA  
United Kingdom  
Telephone: (0) 115 964 0777  
Fax: (0) 115 964 0071  
Email: info@watlow.co.uk  
Website: [www.watlow.co.uk](http://www.watlow.co.uk)  
From outside The United Kingdom:  
Tel: +44 115 964 0777  
Fax: +44 115 964 0071

Watlow Korea Co., Ltd.  
#1406, E&C Dream Tower, 46, Yangpyeongdong-3ga  
Yeongdeungpo-gu, Seoul 150-103  
Republic of Korea  
Tel: +82 (2) 2628-5770 Fax: +82 (2) 2628-5771  
Website: [www.watlow.co.kr](http://www.watlow.co.kr)

Watlow Malaysia Sdn Bhd  
No. 14-3 Jalan 2/114  
Kuchai Business Centre  
Jalan Kuchai Lama  
58200 Kuala Lumpur  
Malaysia  
Tel: +60 3 7980 7741 Fax: +60 3 7980 7739

瓦特龍電機股份有限公司  
80143 高雄市前金區七賢二路189號10樓之一  
電話: 07-2885168 傳真: 07-2885568

Watlow Electric Taiwan Corporation  
10F-1 No.189 Chi-Shen 2nd Road Kaohsiung 80143  
Taiwan  
Tel: +886-7-2885168 Fax: +886-7-2885568

Your Authorized Watlow Distributor

**TOTAL**  
**CUSTOMER**  
**SATISFACTION**  
3 Year Warranty